



Material Testing Laboratory
Faculty of Engineering
Chulalongkorn University

Laboratory Test of weber.smoothing
SPT-67/59



Laboratory Test
of
Weber.smoothing

For

Saint – Gobain Weber Company Limited

Material Testing Laboratory
Department of Civil Engineering
Faculty of Engineering
Chulalongkorn University

Tested by:.....
PITCHA S.

(Dr. Pitcha Jongvivatsakul)

.....

(Prof. Dr. Teerapong Senjuntichai)

Head of Civil Engineering Department



Test Product

Weber.smoothing

Mix Proportion

Water-Cement ratio = 0.24

Test Standards

Type of Test	Test Standard
Compressive Strength of Hydraulic Cement Mortars	ASTM C109
Time of Setting of Hydraulic Cement Mortar by Modified Vicat Needle	ASTM C807
Flexural Strength of Hydraulic Cement Mortars	ASTM C348
Compressive Strength of Hydraulic Cement Mortars	EN 196-1



Type of test: Compressive Strength of Hydraulic Cement Mortars



Specimens from: Saint – Gobain Weber Company Limited

Test product: Weber.smoothing

Mix proportion: W/C = 0.24

Specimen description: 50 mm cubes of Cementations Mortar


Figure of testing:

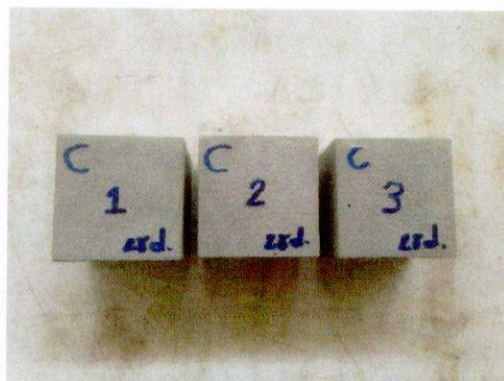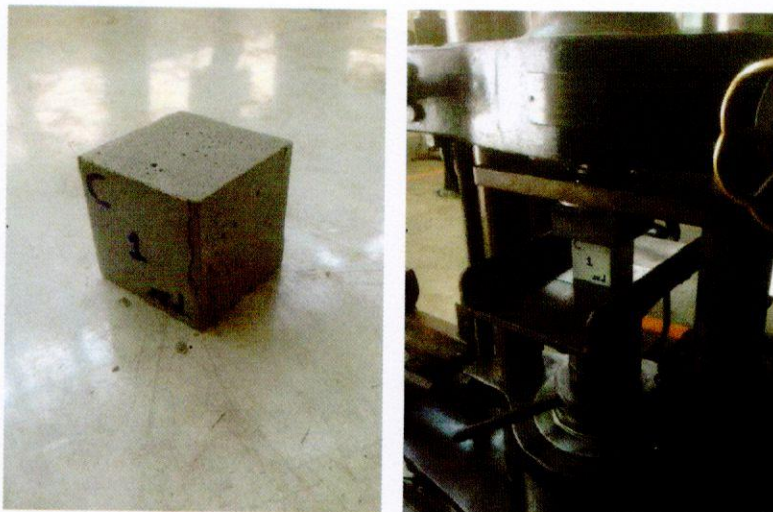



Test results:

Dimension (mm)			Weight (g)	Date		Age (days)	Maximum Crushing Load (kg)	Maximum Crushing Strength (ksc)
A	B	C		Cast	Tested			
50.1	50.9	49.8	201.8	15/06/59	12/07/59	28	3900	152.9
50.0	50.5	49.9	201.4	15/06/59	12/07/59	28	3600	142.6
49.9	50.6	49.9	201.8	15/06/59	12/07/59	28	3900	154.4
Average							3800	149.9

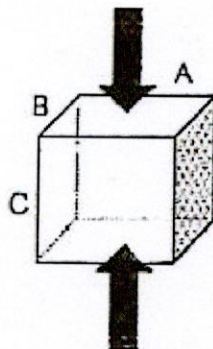

Date: July 12, 2016

Test by:PITCHA S.....

(Dr. Pitcha Jongvivatsakul)



Type of test: Time of Setting of Hydraulic Cement Mortar by Modified Vicat Needle


Specimens from: Saint – Gobain Weber Company Limited

Test product: Weber.smoothing

Mix proportion: W/C = 0.24

Test procedure: A mortar is prepared following mix proportion from the manufacture. Mortar is then tested for time of setting, using the needle of the modified Vicat apparatus for the determination of a stipulated penetration. The time required to obtain the stipulated penetration of the modified Vicat needle is the time of setting.

Figure of testing:

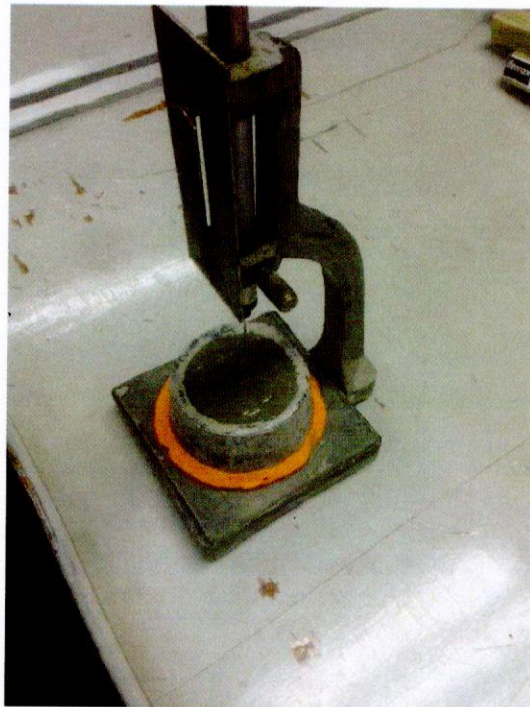



Test results:

Time of Measurement	Elapsed Time	Penetration
	(min)	(mm)
11:15	0 (Mixing)	40
11:45	30	40
12:15	60	40
12:45	90	40
13:15	120	40
13:45	150	40
14:15	180	40
14:45	210	40
15:15	240	40
15:45	270	38
15:55	280	36
16:05	290	36
16:15	300	36
16:25	310	31
16:35	320	26
16:45	330	21
16:55	340	8
17:05	350	3
17:15	360	2
17:25	370	2
17:35	380	2
17:45	390	1
17:55	400	1
18:05	410	1
18:15	420	1
18:25	430	1
18:35	440	0
18:45	450	0
18:55	460	0
19:05	470	0
Initial Setting Time (min)		322
Final Setting Time (min)		440

Date: July 12, 2016

Test by: PITCHA J

(Dr. Pitcha Jongvivatsakul)



Type of test: Flexural Strength of Hydraulic Cement mortars



Specimens from: Saint – Gobain Weber Company Limited

Test product: Weber.smoothing

Mix proportion: W/C = 0.24

Specimen description: Test prisms are 40 by 40 by 160-mm.


Figure of testing:

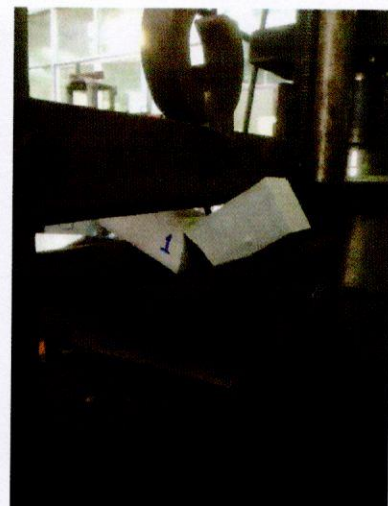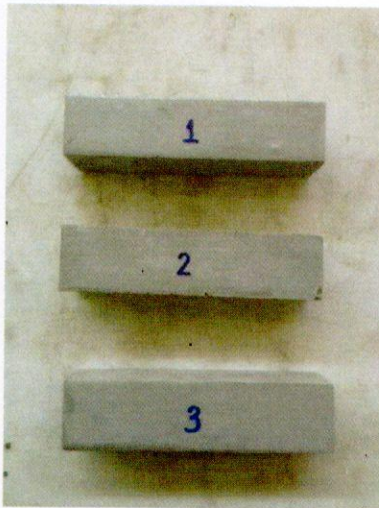



Test results:

Dimension (mm)			Weight (g)	Date		Age (days)	Maximum Load (kg)	Maximum Flxural Strength (ksc)
A	B	C		Cast	Tested			
40.4	40.0	160.11	409.6	15/06/59	12/07/59	28	180	50.4
40.4	40.2	160.15	417.6	15/06/59	12/07/59	28	180	50.4
40.7	40.4	160.10	412.0	15/06/59	12/07/59	28	180	50.4
Average							180	50.4



Date: July 12, 2016

Test by: *PITCHA J.*

(Dr. Pitcha Jongvivatsakul)



Type of test: Compressive Strength of Hydraulic Cement Mortars


Specimens from: Saint – Gobain Weber Company Limited

Test product: Weber.smoothing

Mix proportion: W/C = 0.24

Test procedure: The prism halves (after test of flexural strength) are tested in compression. Centre the prism halves laterally to the auxiliary platens of hard steel, which exactly determine the compressive area (because the prism halves have an irregular form). According EN 196-1, the size of the platens is 40 mm x 40 mm and they are at least 10 mm thick. Increase the load smoothly at the rate of 2400 ± 200 N/s over the entire load application until fracture.

Picture of testing:


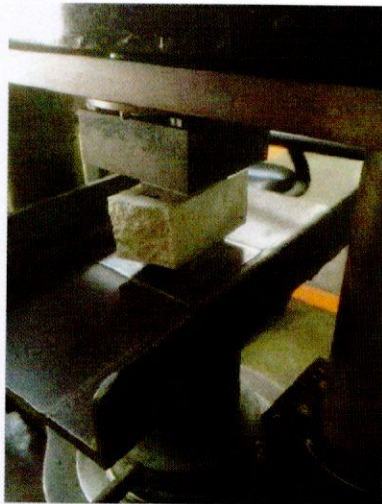




Test results:

No	Dimension (mm)			Date		Age (days)	Maximum Crushing Load (kg)	Maximum Crushing Strength (ksc)	Remark
	A	B	C	Cast	Tested				
1	40.4	40.0	80	15/06/59	12/07/59	28	140	8.75	
	40.4	40.0	75			28	150	9.37	
2	40.3	40.1	80	15/06/59	12/07/59	28	170	10.62	Variation > 10 %
	40.3	40.1	75			28	140	8.75	
3	40.4	40.2	80	15/06/59	12/07/59	28	160	10.0	
	40.7	40.4	65			28	150	9.37	
						Average	148	9.29	Average of 5 specimens0

Note: If one result within the six determinations varies by more than $\pm 10\%$ from the mean of the six, discard this result and calculate the mean of the five remaining results.

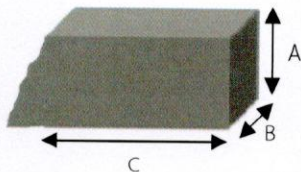

Date: July 12, 2016

Test by: Pitcha J.

(Dr. Pitcha Jongvivatsakul)



This report is issued under the following conditions:

This report applies to the specimen of the specific product given at the time of its testing. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that Chulalongkorn University approves, recommends or endorses the manufacturer, supplier or user of such product, or that Chulalongkorn University in any way “guarantees” the later performance of the product.

The specimen/s mentioned in this report is/are submitted/supplied/manufactured by the client. Chulalongkorn University therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.

No part in this report shall be interpreted to mean that Chulalongkorn University has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that specimen.

This report shall not be reproduced wholly or in parts and no reference shall be made by the client to Chulalongkorn University or to the report or results furnished by Chulalongkorn University in any advertisements or sales promotion.